




ALTERNATIVES

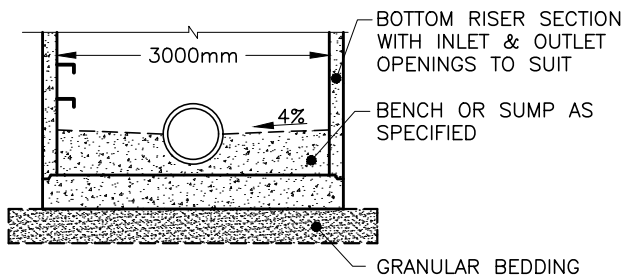


A. PRECAST SLAB BASE

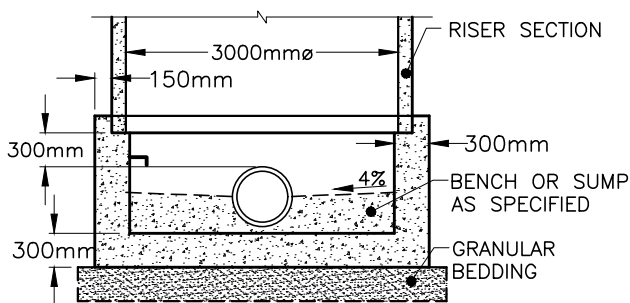


B. CAST-IN-PLACE BASE

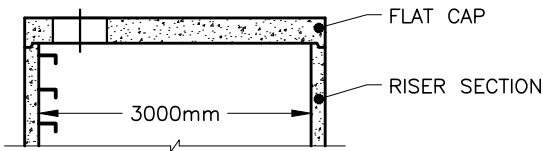

C. 3000mm PRECAST FLAT CAP

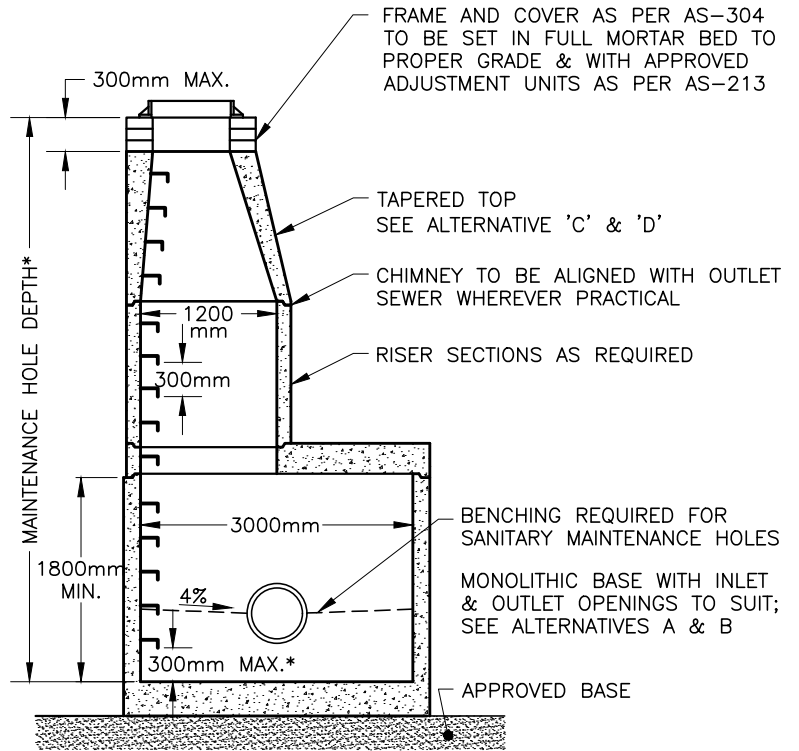

*MEASURED TO BENCHING OR SUMP, WHICHEVER IS APPLICABLE

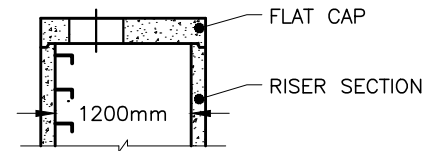


D. 1200mm PRECAST FLAT CAP

NOTES:

1. THE SUMP IS MEASURED FROM THE LOWEST INVERT, FOR SUMP DETAIL SEE AS-314A.
2. COMPACTED GRANULAR 'A' BACKFILL SHALL BE PLACED TO A MINIMUM THICKNESS OF 300mm ALL AROUND THE MAINTENANCE HOLE.
3. PRECAST CONCRETE COMPONENTS SHALL BE ACCORDING TO OPSD 701 & 703 SERIES.
4. PIPE SUPPORT SHALL BE CLASS 'A' BEDDING TO FIRST PIPE JOINT BEYOND MANHOLE (RIGID PIPE) OR A FLEXIBLE JOINT WITHIN 900mm OF MANHOLE WALL (RIGID OR FLEXIBLE PIPE) WITH SEWER STONE BEDDING.
5. MAINTENANCE HOLE STEPS IN ACCORDANCE WITH AS-305.
6. FROST STRAPPING FOR SANITARY MANHOLES AS PER OPSD 701.100 TO EXTEND 2.0m BELOW FINISHED GRADE (1.0m BELOW FROST DEPTH).
7. CAST-IN-PLACE BASES TO BE TO THE SATISFACTION OF THE CITY ENGINEER.

NOT TO SCALE

 CITY OF WINDSOR ENGINEERING DEPARTMENT	
PRECAST MAINTENANCE HOLE 3000mm DIAMETER	
DR'N BY: SS, NB, AZ	DATE: JUN, 2017
REV. DATE: JUN, 2024	CH'KD BY (ENG): PM, JH
CH'KD BY (GEO/OPS): PJU, AL	PASSED BY: FM
_____ CITY ENGINEER	
AS-314E	